


# FUNNELS

## DRIP AND CONDENSATE FUNNELS

**FUNCTION:** Ideal for hospitals and industrial laboratories where indirect waste lines above the floor require receptors to receive drip, condensate or waste water. Use of "P" trap recommended for preventing sewer gases from entering room.

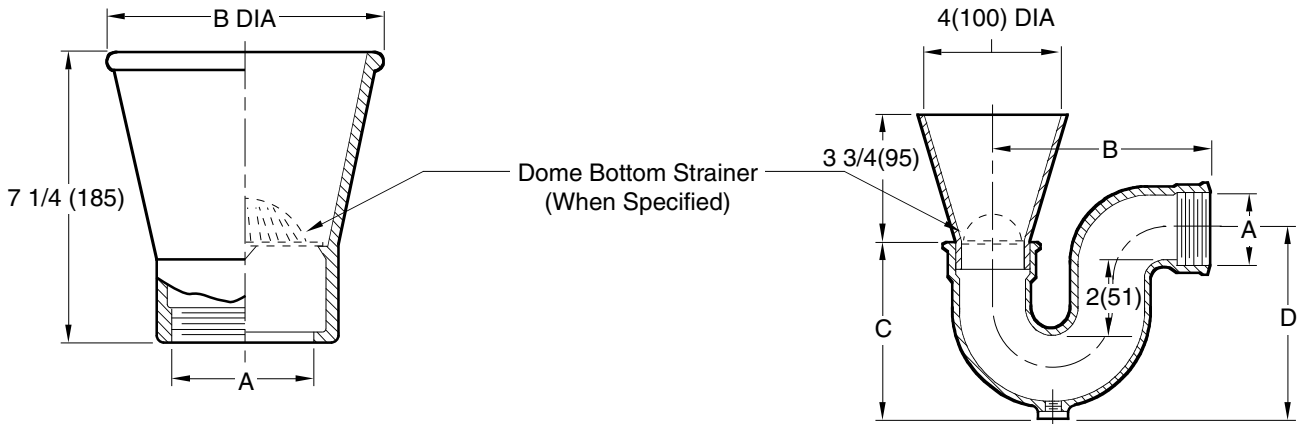

**CAULK OUTLET**

A = PIPE SIZE	02(50)	03(75)	04(100)	06(150)
B	6(150)	7(180)	8(205)	10(255)

**THREADED OUTLET ONLY**

A = PIPE SIZE	B	C	D
0150(40), 02(50)	6(150)	5(125)	5 1/2(140)
03(75)	6(150)	6(150)	6(150)

- Fig. 3811C ... DUCO CAST IRON WITH ACID RESISTANT COATED INTERIOR AND EXTERIOR
- Fig. 3812C ... DUCO COATED CAST IRON
- Fig. 3813C ... CAST BRONZE
- Fig. 3814C ... POLISHED CHROME PLATED CAST BRONZE
- Fig. 3821T
- Fig. 3822T
- Fig. 3823T
- Fig. 3824T

**REGULARLY FURNISHED:**  
 As described by Figure Number.

- VARIATIONS:**
- Aluminum Dome Bottom Strainer -DBS
  - Dome Bottom Strainer (Same finish and materials as described by Figure No.)
  - Less Cleanout (Fig. 3820 Series only)
  - With Front Cleanout (Fig. 3820 Series only)
  - NO-HUB Adaptor 02(50), 03(75), 04(100) or 06"(150) sizes only (Specify Fig. 2646Y)
  - T Threaded Outlet

**OPTIONAL MATERIALS:**  
 All Galvanized -G

**NOTE:** Dimensions shown in parentheses are in millimeters.

FIGURE NUMBER 3811, 3812, 3813, 3814 3821, 3822, 3823, 3824

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
							3811, 3812, 3813, 3814 3821, 3822, 3823, 3824

DRAWING NUMBER S3811

SIZE A

SCALE: NONE

DATE: 9-19-85

APPROVED BY: SJM

CHECKED BY: JD

DRAWN BY: PJ

D